


NOTE:-
 1. STANDARD CONFIGURATION SHOWN.
 2. ALTERNATIVE CONFIGURATION :- BACKFLOW PREVENTION NOT REQUIRED. OMIT TESTABLE DEVICE AND VALVES, AND REPLACE WITH NON-TESTABLE SINGLE CHECK VALVE.

BYPASS PIPE SIZE TO BE 25mm, FOR UP TO 3 FIRE HOSE REELS CONNECTED TO SERVICE.
 BYPASS PIPE SIZE TO BE 40mm, FOR MORE THAN 3 FIRE HOSE REELS CONNECTED TO SERVICE.
 FOR ALTERNATIVE CONFIGURATION, BYPASS PIPE SIZE TO SUIT.

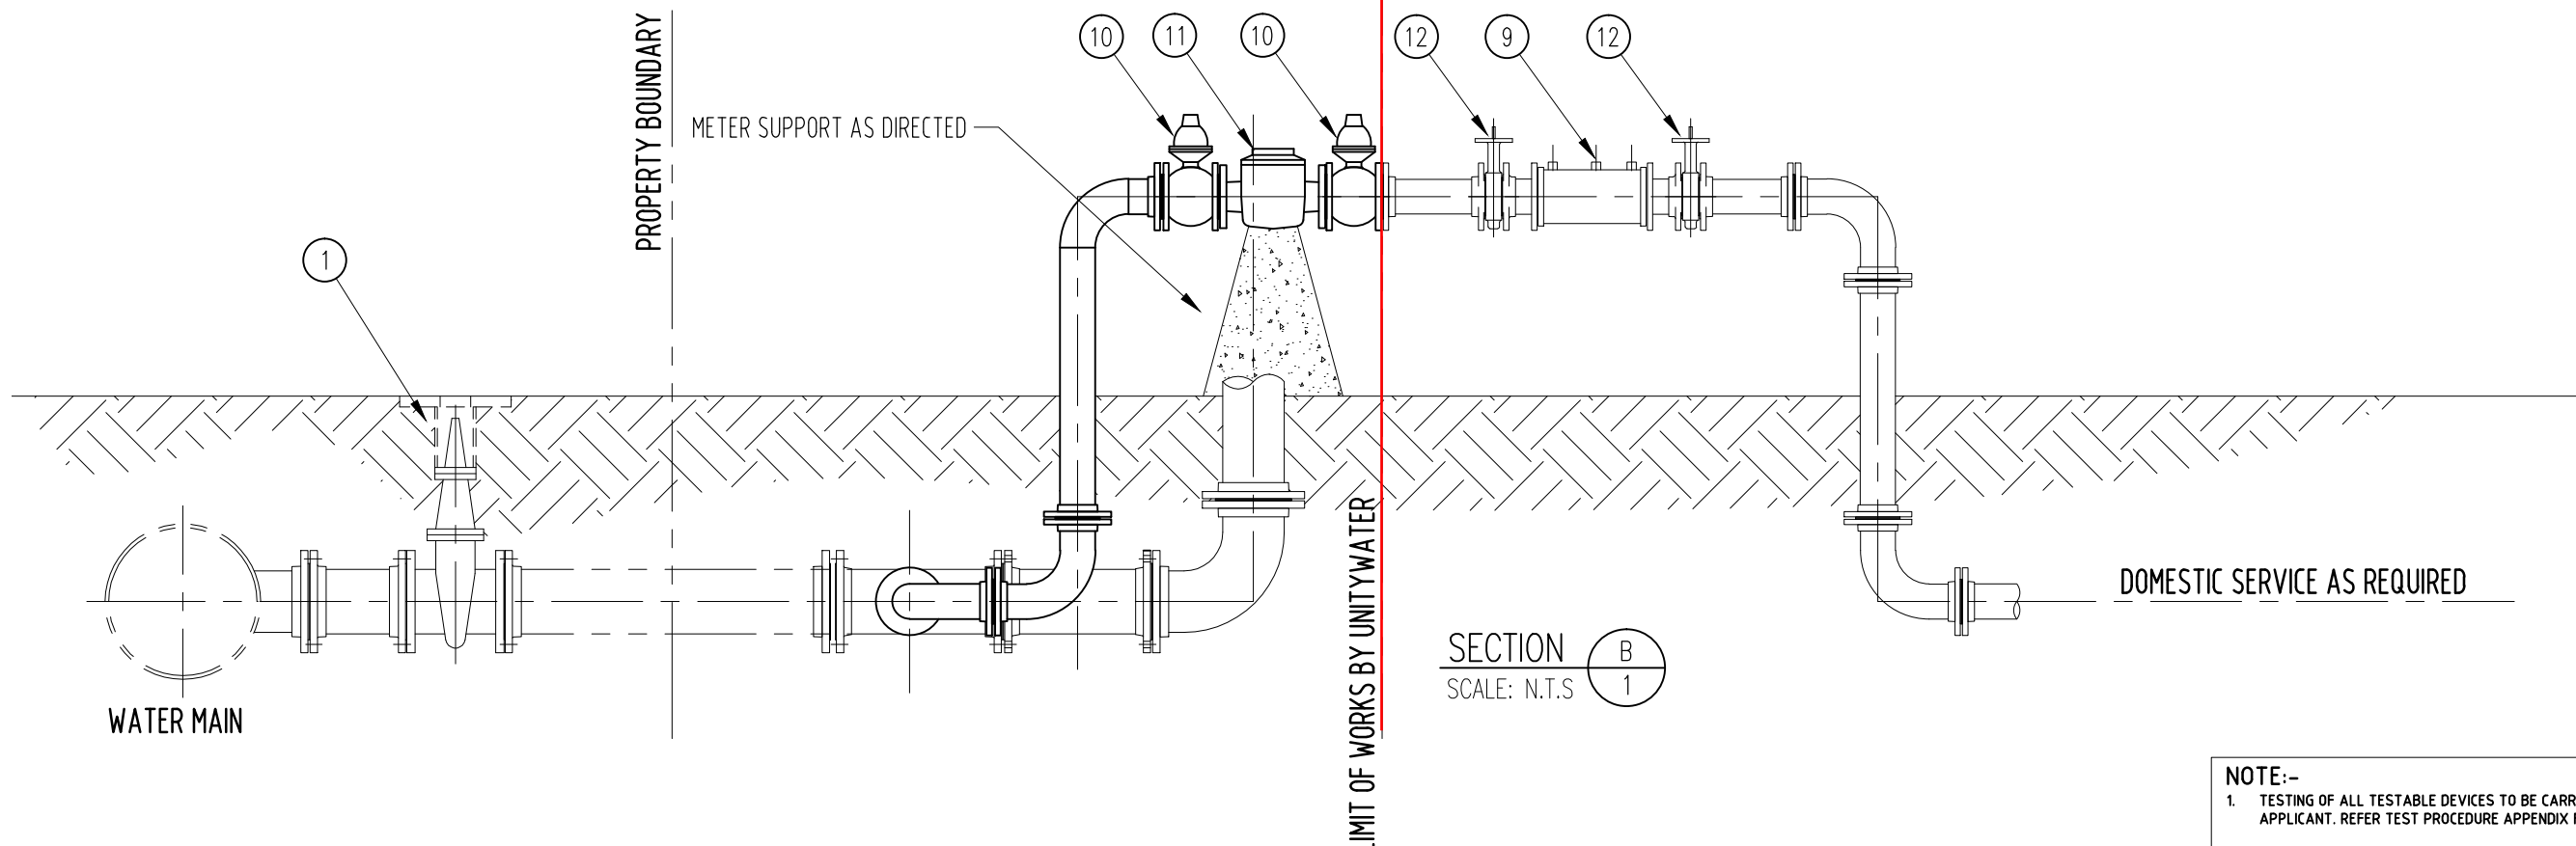

NOTE:-
 1. TESTING OF ALL TESTABLE DEVICES TO BE CARRIED OUT BY APPLICANT. REFER TEST PROCEDURE APPENDIX F/G/1 AS2845:3-2010.

A1	2	30.11.11	CHECK VALVE HOLDING PRESSURE ADDED	C.B.	M.F.	M.F.	Director Engineering Services
	1	11/10/11	AS STANDARD NUMBER CORRECTED - TITLE DESCRIPTION CHANGED	C.B.	M.F.	M.F.	
	0	26.9.11	ISSUED FOR USE	C.B.	M.F.	M.F.	
	3	3/4/12	PIPEWORK ALTERED	J.M.	M.F.	M.F.	
INDEX	DATE	REVISIONS	DRAWN	CHECKED	PASSED	Date	

DRAWN	C.B.	15.9.11
CHECKED		
PASSED		
INITIALS	DATE	



Unitywater
 UNITYWATER
 TYPICAL DOMESTIC / FIRE SERVICE DETAIL
 SECTIONAL VIEW

SCALE	1:10
SHEET	2 OF 2 SHEETS
DRAWING NO.	2 1 0 3
W6885-2	